

Online data supplement

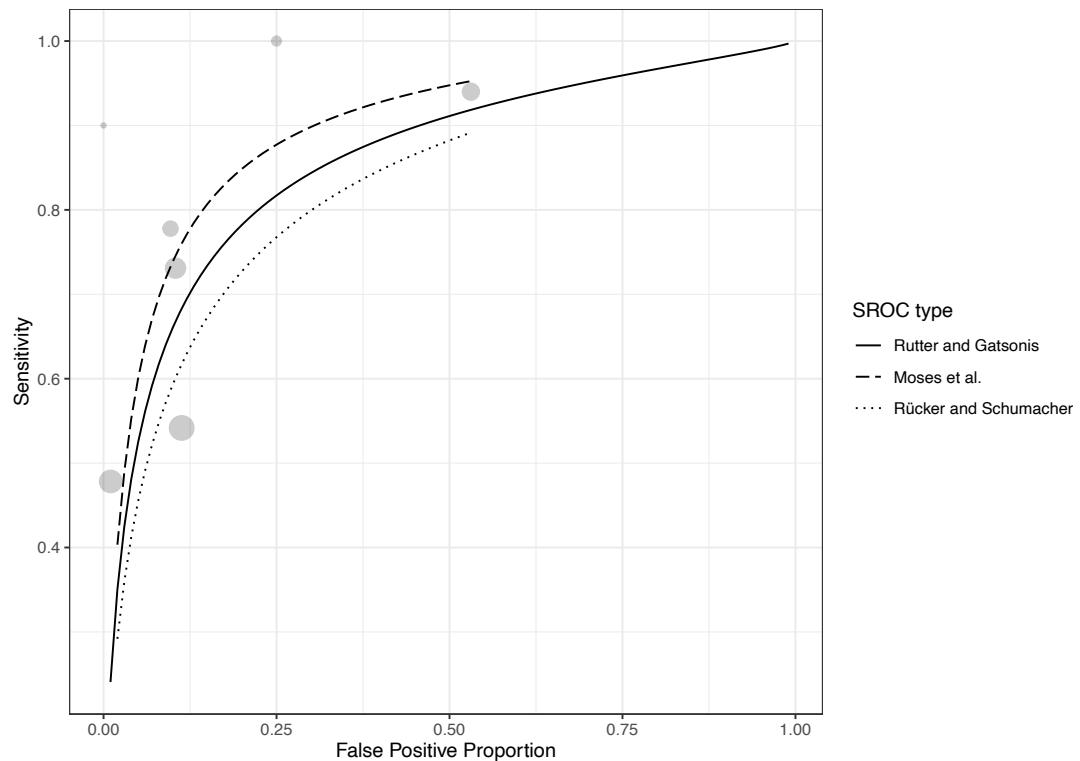


Figure E1

Summary ROC curves of studies using the Rad-57® device

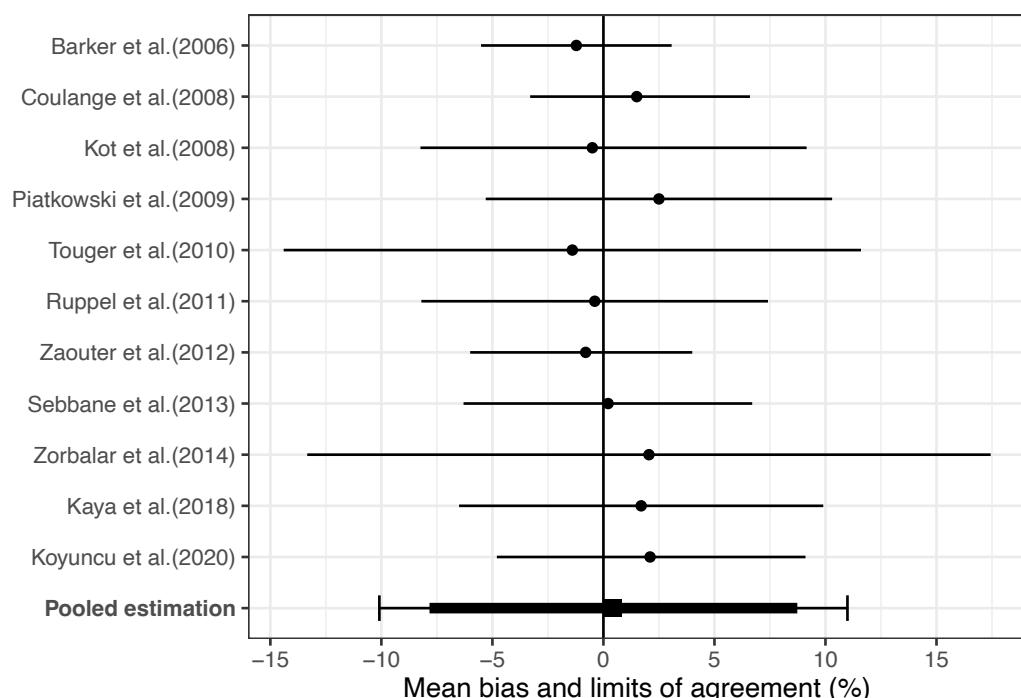


Figure E2

Limits of agreement of studies using the Rad-57® device

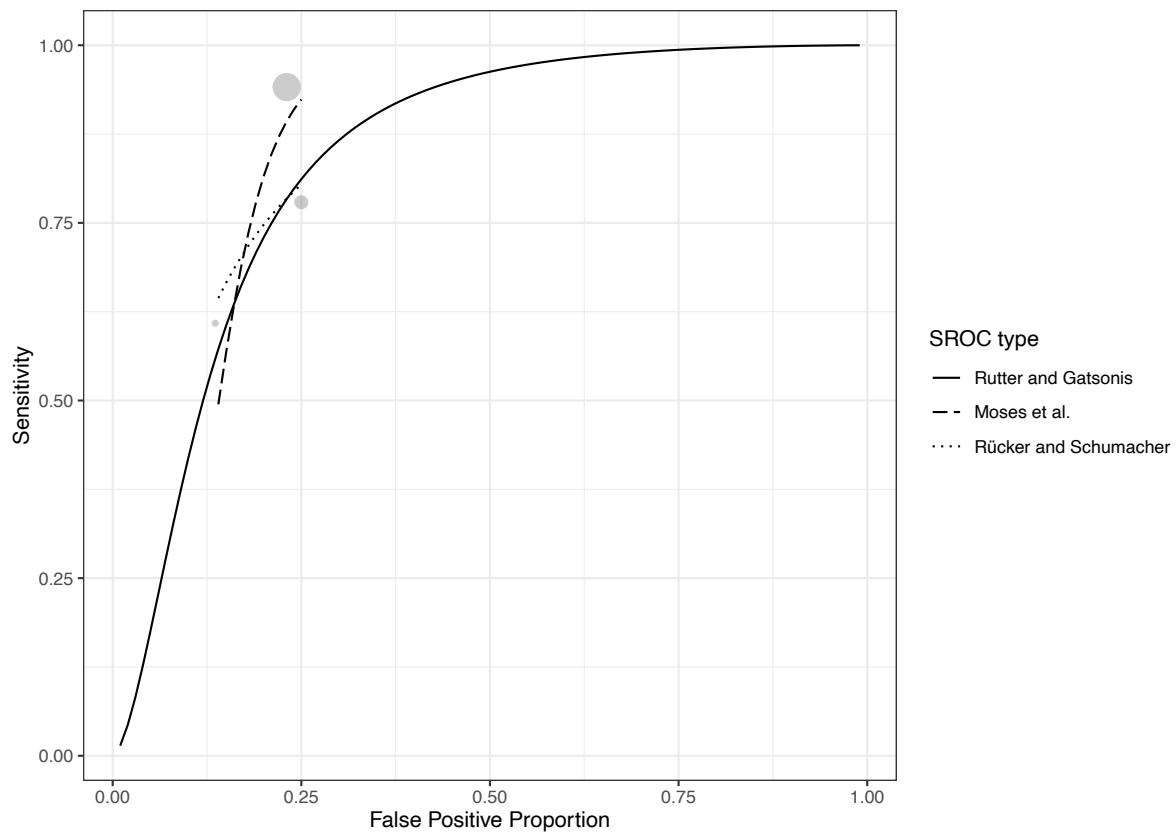


Figure E3
Summary ROC curves of studies using the Radical-7® device

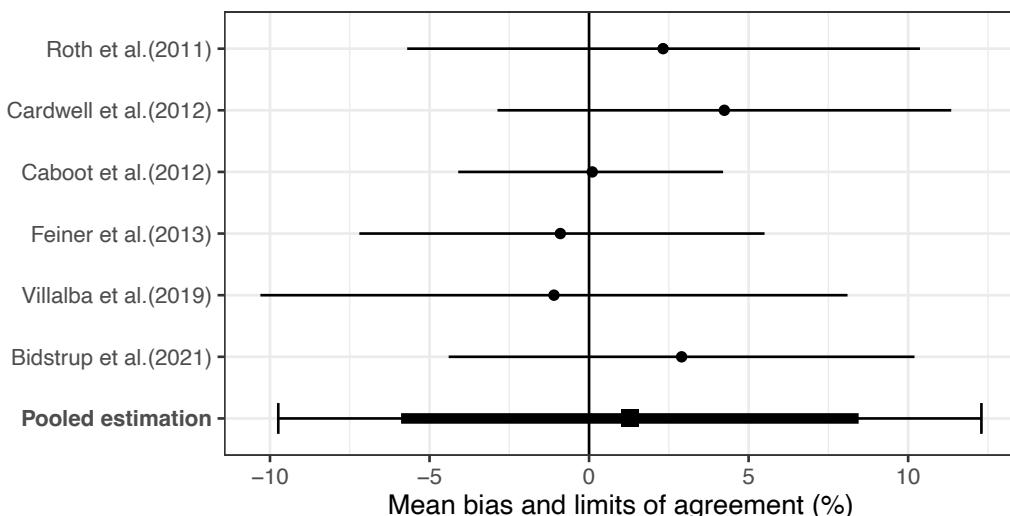


Figure E4
Limits of agreement of studies using the Radical-7® device

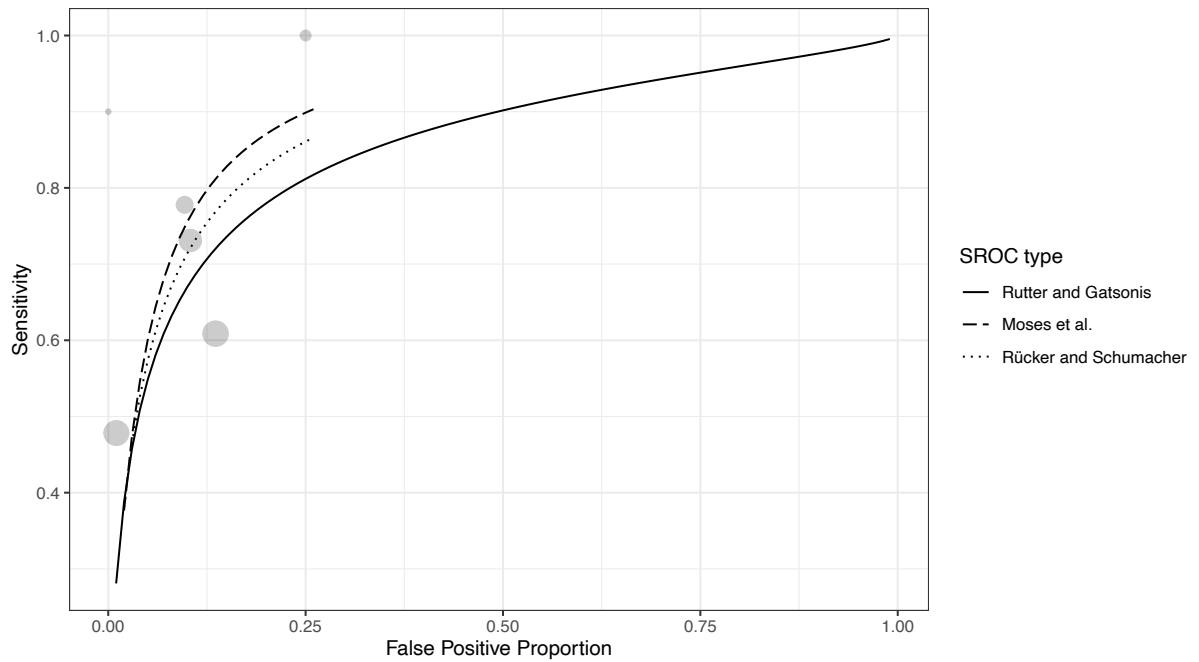


Figure E5

Summary ROC curves of studies including subjects with suspected carbon monoxide poisoning

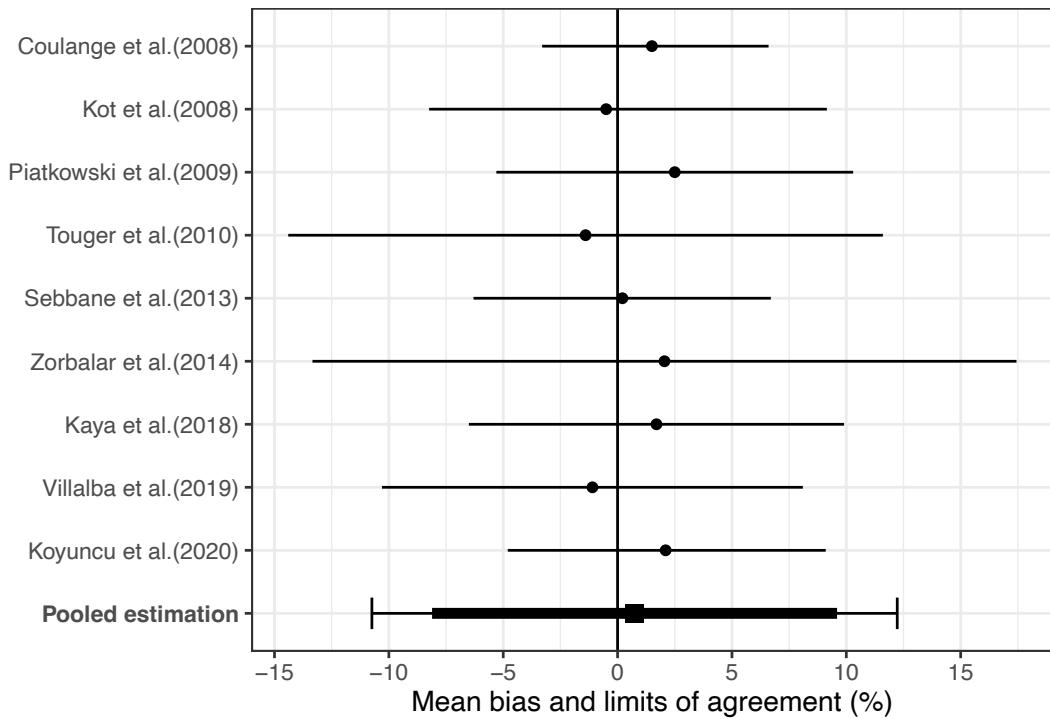


Figure E6

Limits of agreement of studies including subjects with suspected carbon monoxide poisoning